



CARPENTER ASSOCIATES

CONSULTING ENGINEERS

Addendum #1

Project: City of Bangor
690 Maine Avenue Roof Renovations

Job: 16048

Date: 03/29/2016

The following modifications shall be made a part of the Bid Documents dated March 18, 2016.


1. The existing standing seam metal roof shall have 2" pre-cut flute filler POLY-ISO. The 1/2" HD-ISO GARD cover board will be installed over both flute filler and the ribs of existing S.S. Roof. The cover board shall be mechanically fastened through the flute filler into the existing metal roof. The fasteners must penetrate the existing S.S. Roof a minimum of 3/4". The mechanical fasteners must be installed according to manufacturer's guidelines. The EPDM membrane is attached, utilizing a low-voc bonding adhesive and must be installed per manufacturer's specifications. The project will require a 20-yr., 90 mph manufacturer's warranty upon completion.
2. Use LSFR membrane and fire-rated assemblies.
3. FM refers to require factory mutual approved components and assemblies.

See attached detail.

End of Addendum #1


Randy Bragg, P.E.



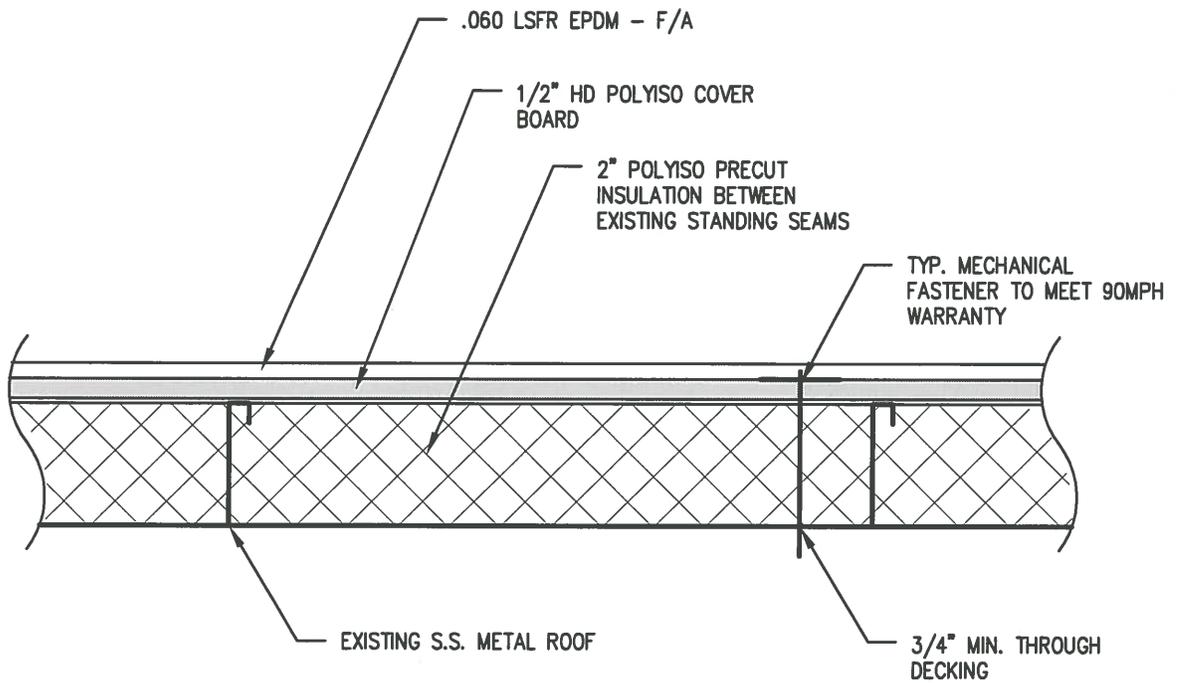

TYP. ROOF SECTION
NOT TO SCALE



Drawn: JE
Checked: RB
Scale: AS NOTED

Date: 03-29-2016
Project No: 16048

CARPENTER ASSOCIATES
CONSULTING ENGINEERS
OLD TOWN MAINE 04468

CITY OF BANGOR
ROOF RENOVATION
690 MAINE AVENUE BANGOR, MAINE

ADDENDUM 1

1